


2002/03 B.C. Hydro Bulk Transmission System Incremental Transmission Losses

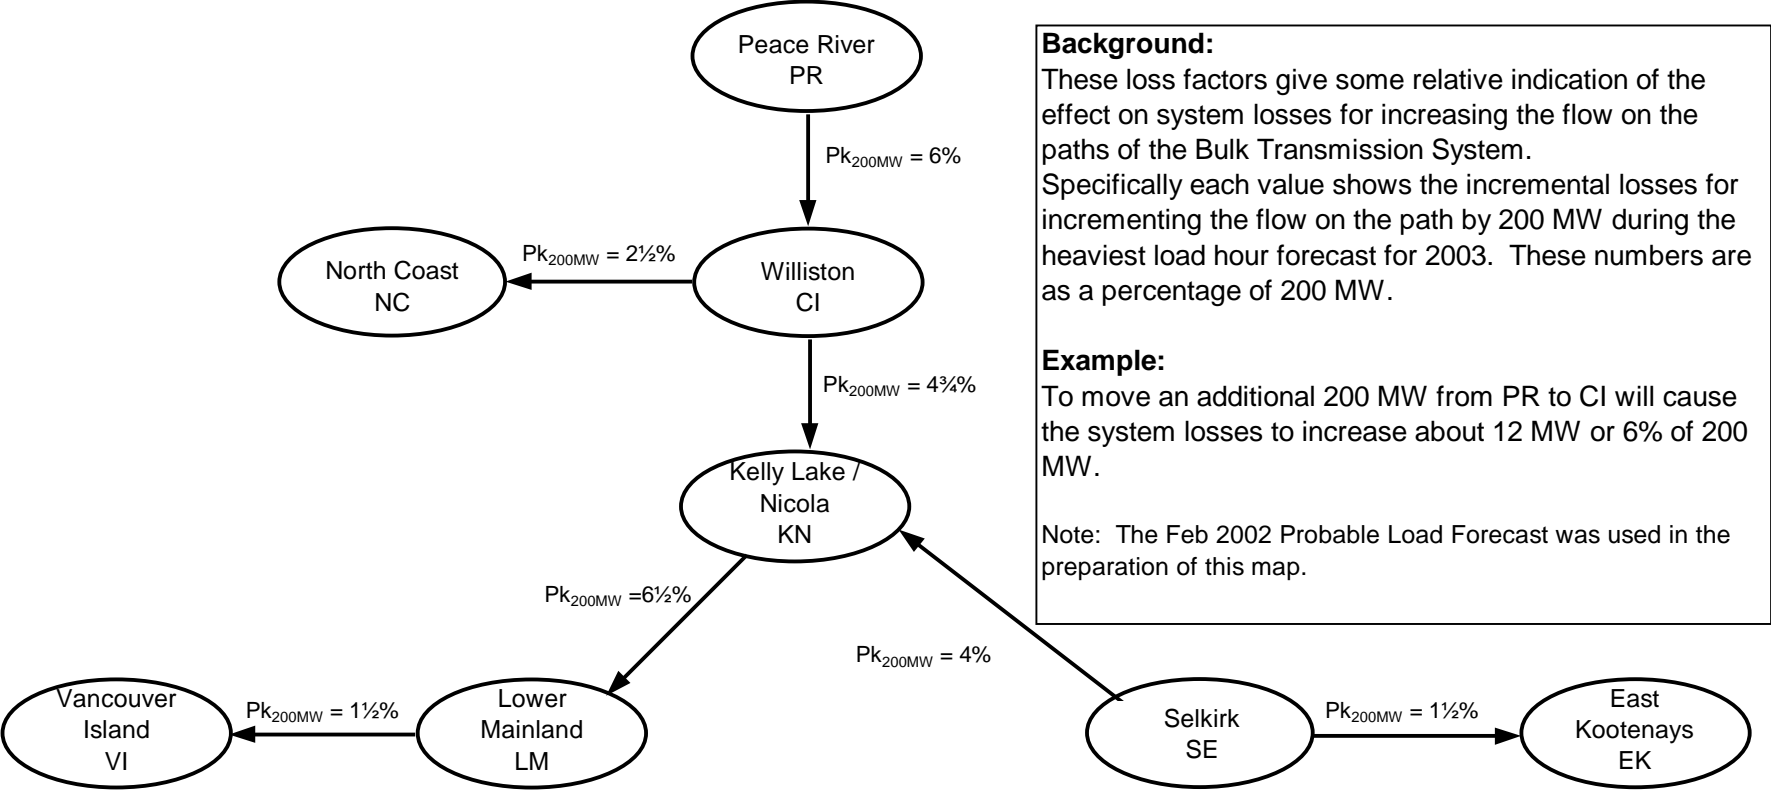

Background:
 These loss factors give some relative indication of the effect on system losses for increasing the flow on the paths of the Bulk Transmission System. Specifically each value shows the incremental losses for incrementing the flow on the path by 200 MW during the heaviest load hour forecast for 2003. These numbers are as a percentage of 200 MW.

Example:
 To move an additional 200 MW from PR to CI will cause the system losses to increase about 12 MW or 6% of 200 MW.

Note: The Feb 2002 Probable Load Forecast was used in the preparation of this map.